

FIGURE 1

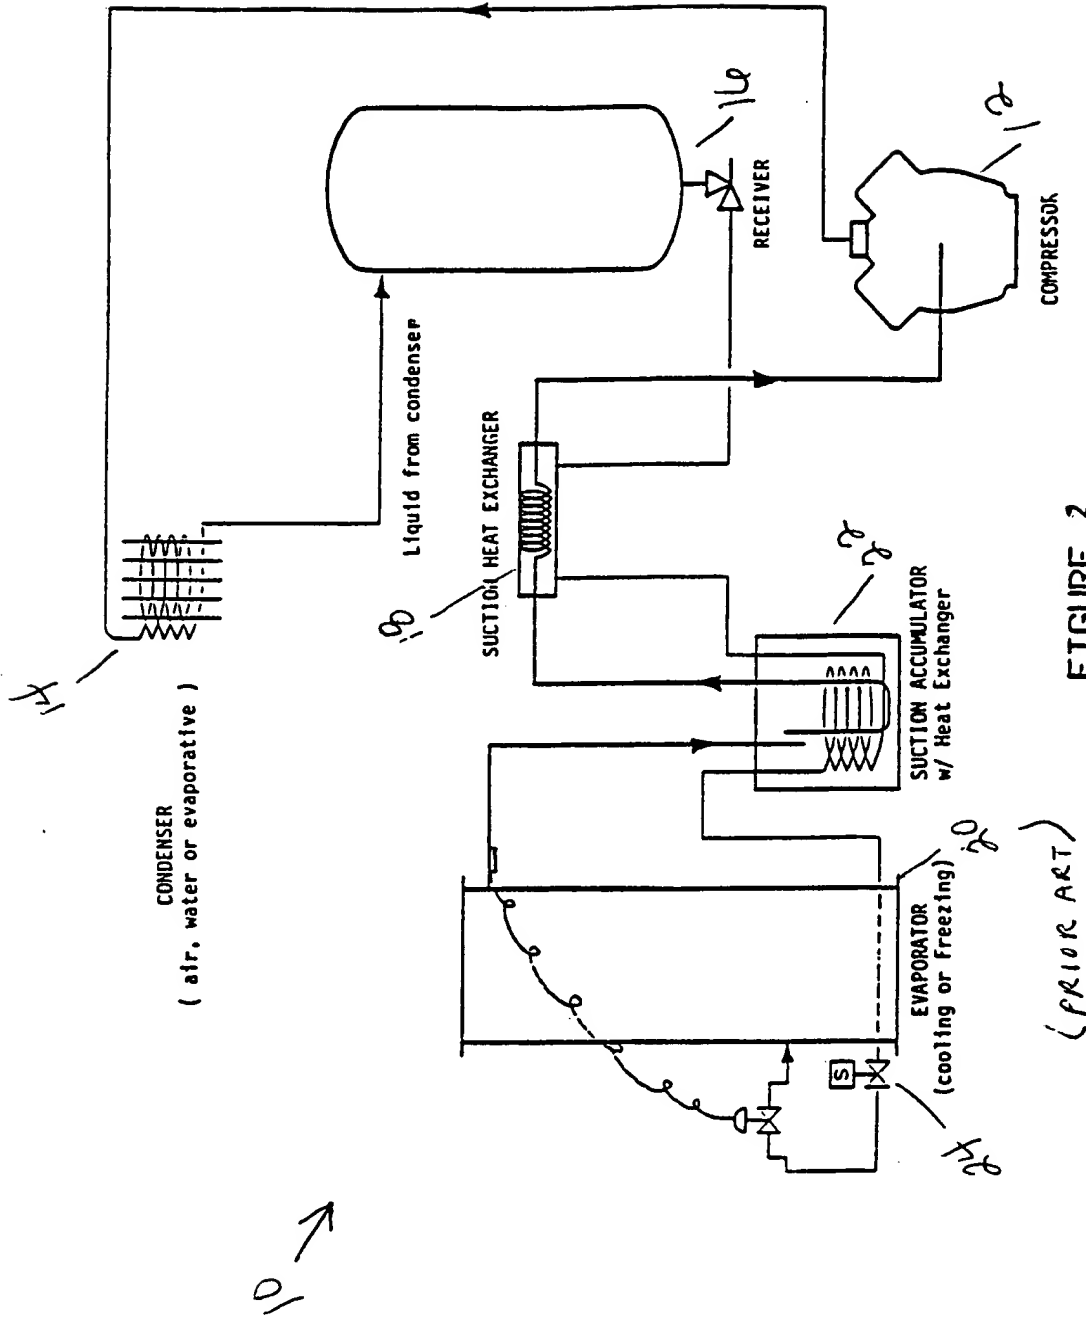


FIGURE 2

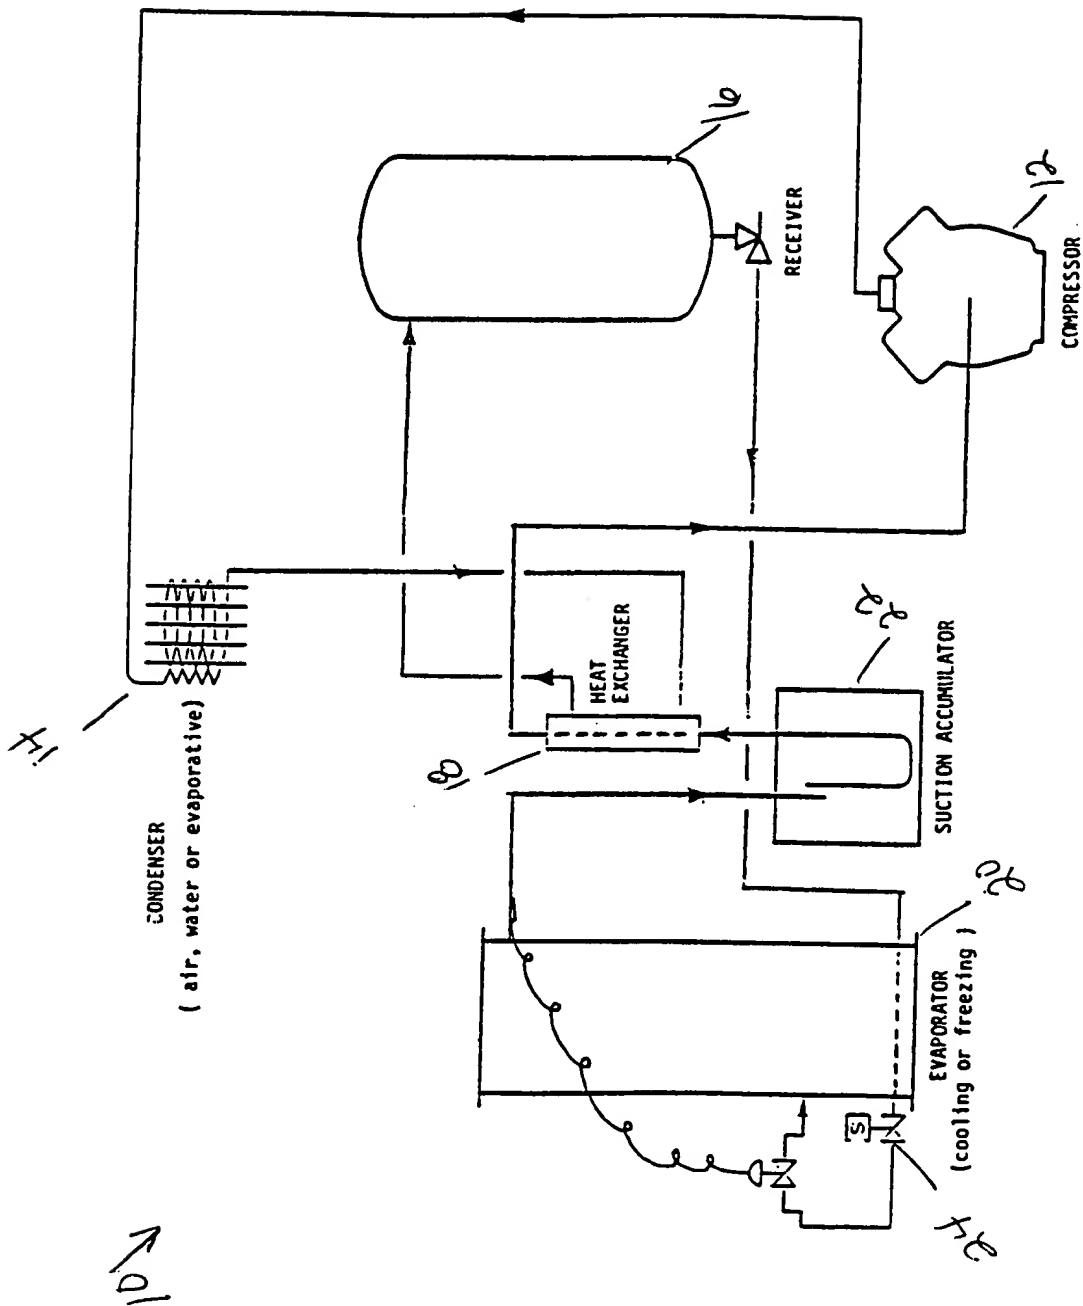


FIGURE 3

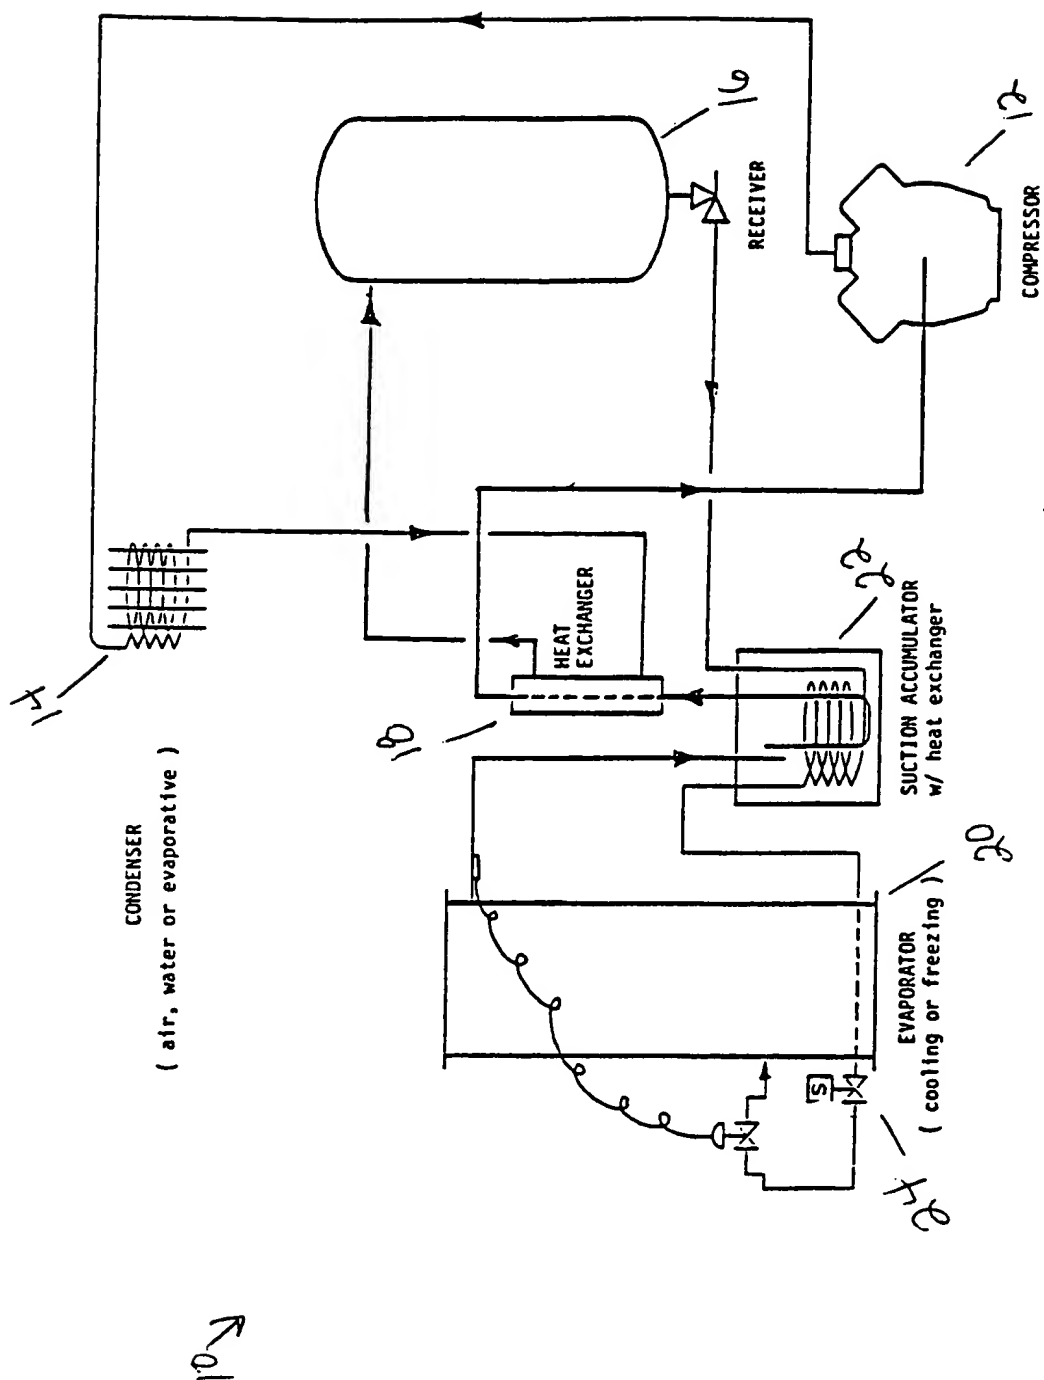


FIGURE 4

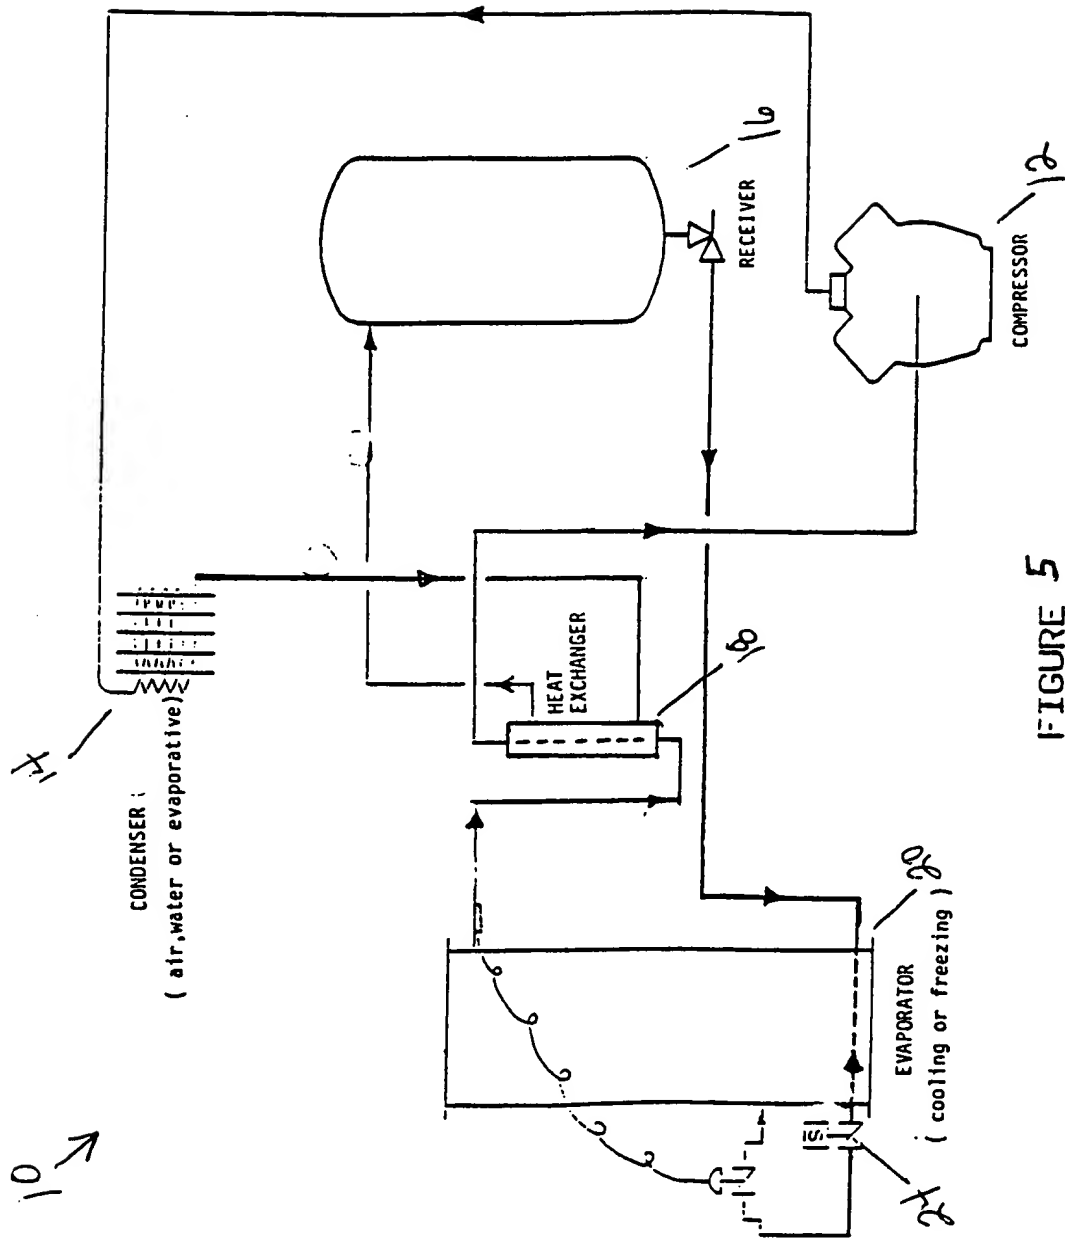


FIGURE 5

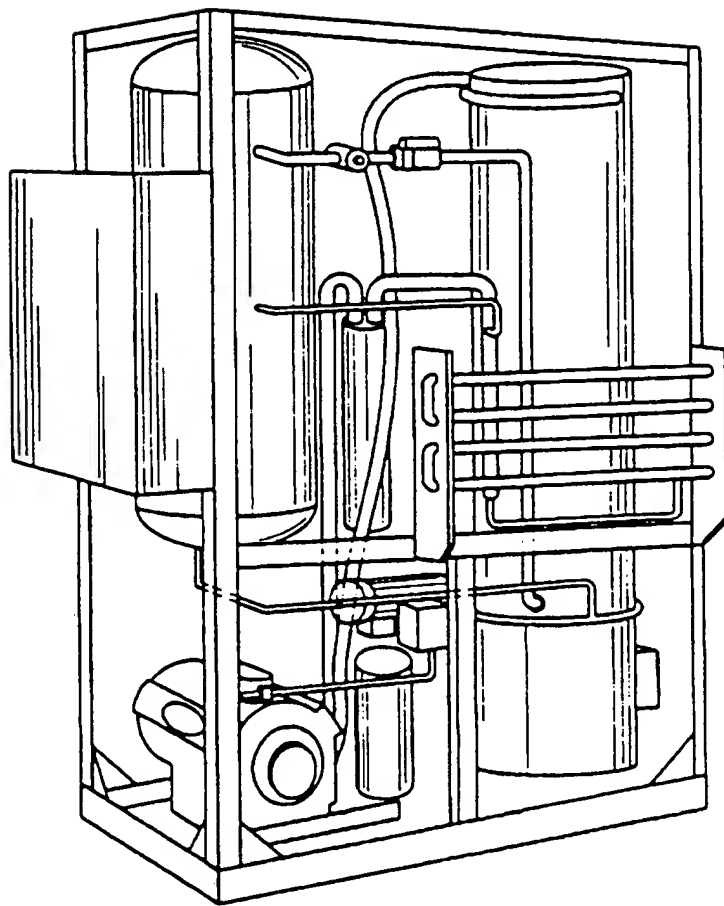


FIGURE 6

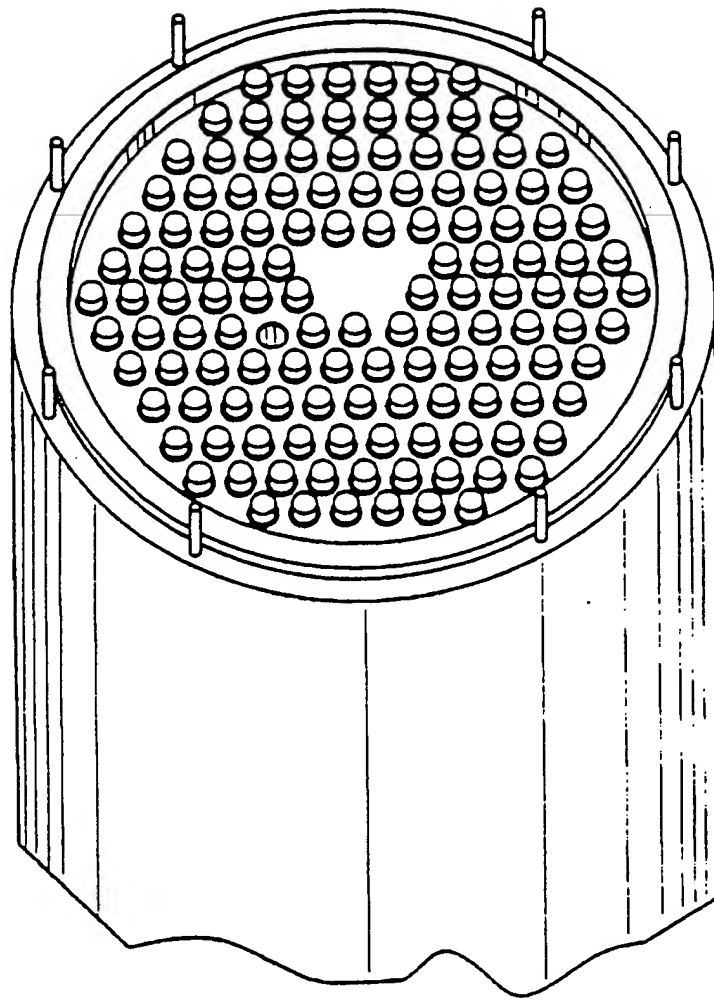


FIGURE 7


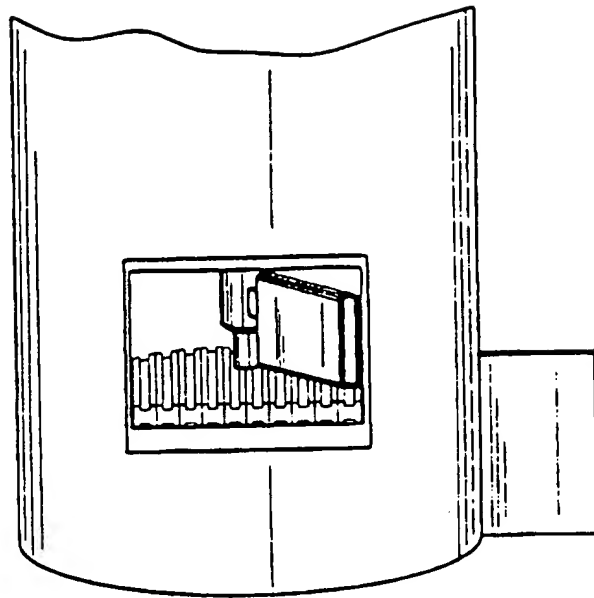


FIGURE 8

IPFX

(Inverted Para - Flow Cross Pipe)

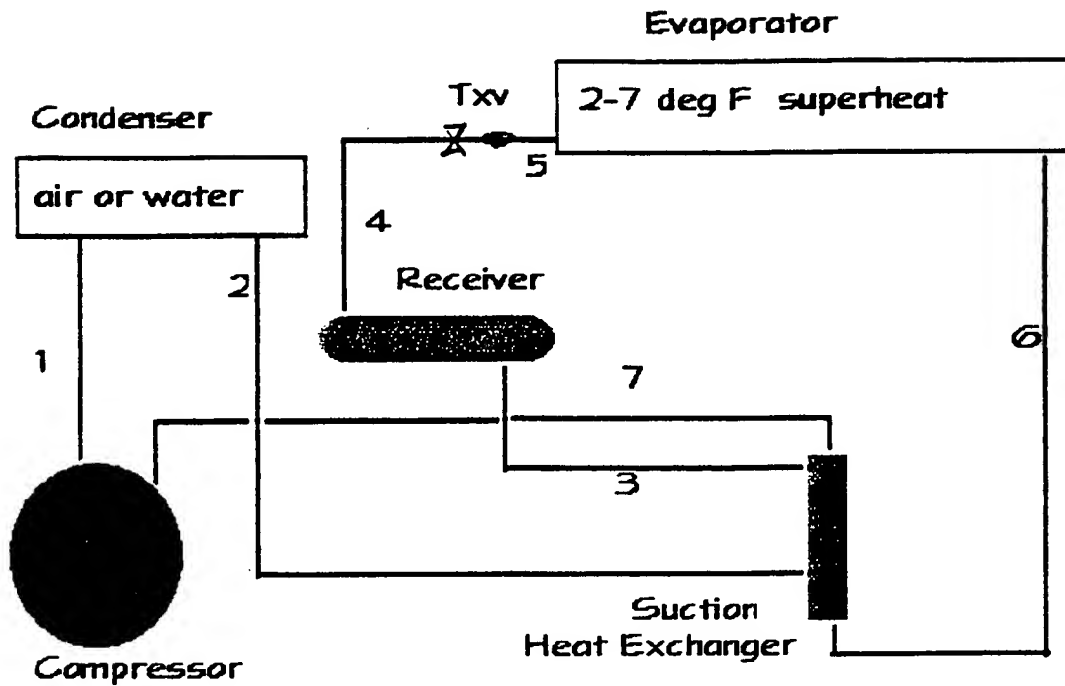

No. 1 - 7 illustrate the flow of refrigerant starting at the compressor discharge.

FIGURE 9

BTU/hr CAPACITY

1 H.P. Compressor

WO 97/38269

PCT/US97/06818

08/983332


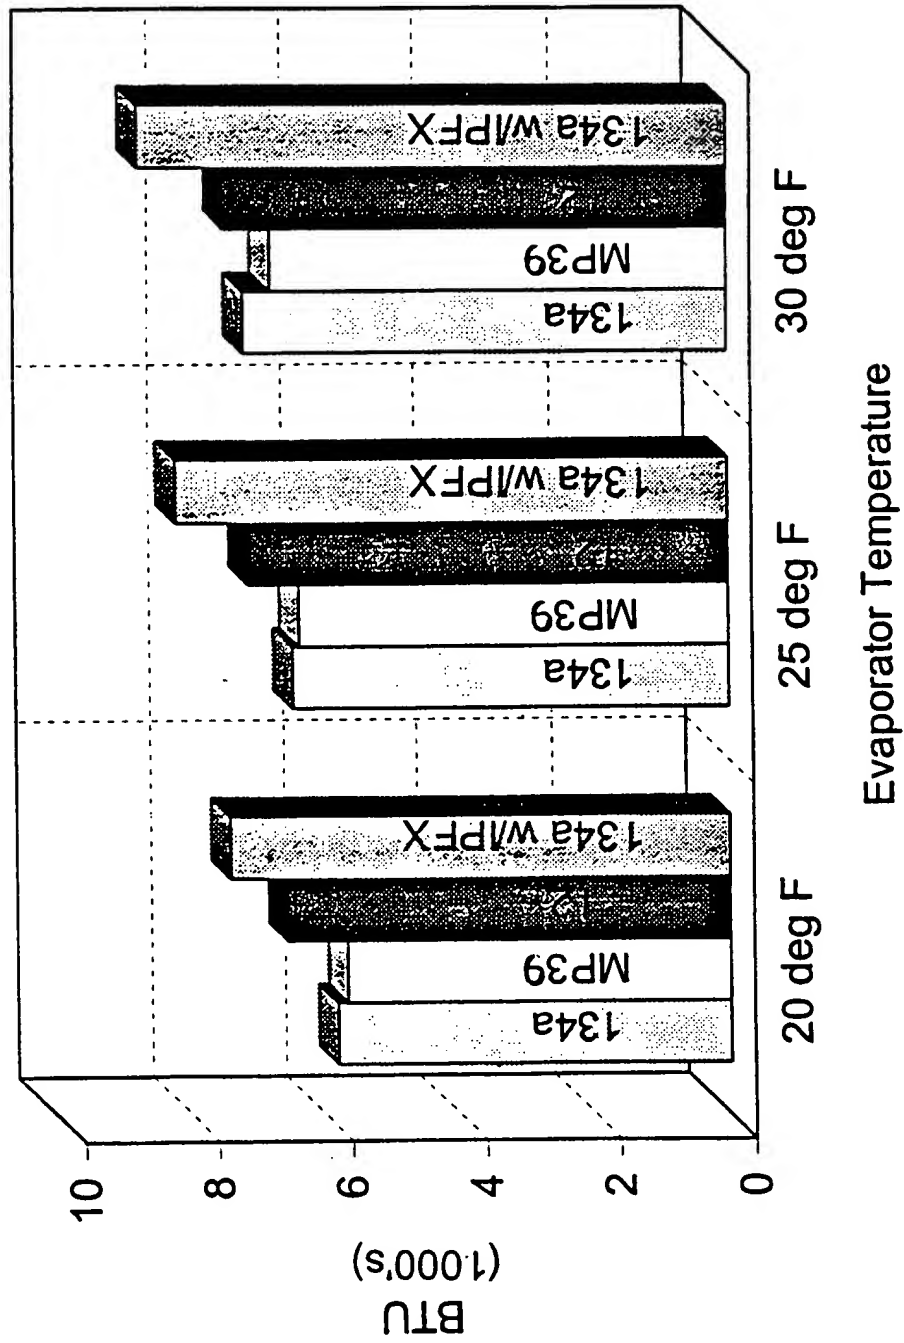


FIGURE 10

00000000000000000000

BTU/hr CAPACITY

1/4 H.P. Compressor

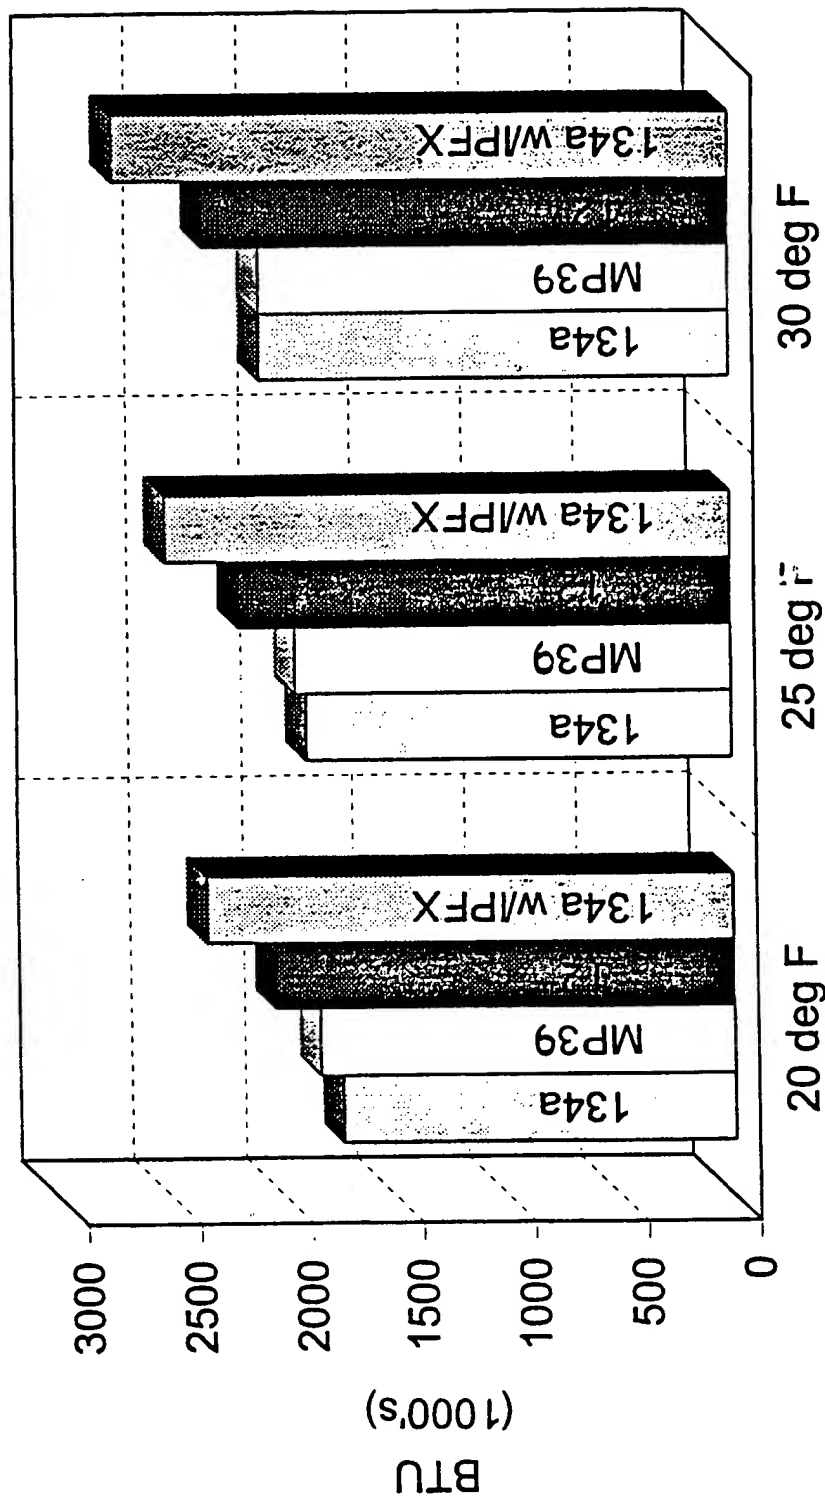

Evaporator Temperature

FIGURE 11